



External electrical connections

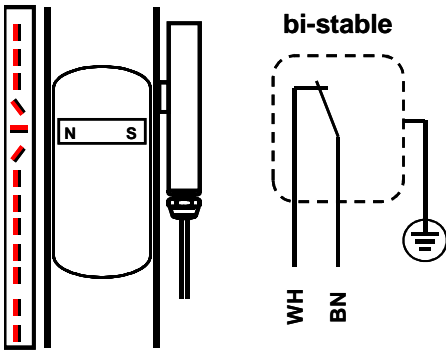

- Installed opposite to indication rail
- Cable exit downwards

Dimensions

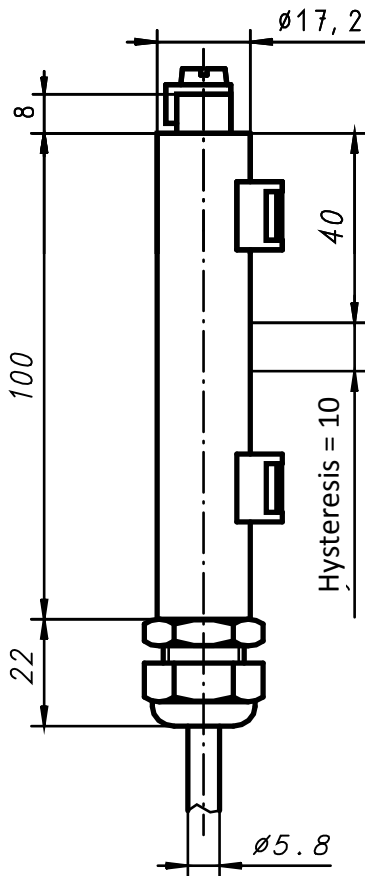

Instruction manual

Function Magnetic switch for WEKA- VLI

The magnetic switch is mounted outside of the float chamber opposite to the indication rail. The switching logic can be reversed by inverting the switch module with cable-exit upwards or by installing the switch module adjacent to the indication rail where technically authorised (see datasheet 20010501).

The magnet inside the float activates the reed switch, when the liquid in the float chamber reaches that level.

Please refer to the safety guidelines.

Product code	(standard) 31130-NI/3	with 3m cable
	31130-NI/5	with 5m cable
	31130-NI/10	with 10m cable
	31130-NI/20	with 20m cable

Switching logic on/off, bi-stable

Electrical data:

Only for connection to certified intrinsically safe circuits with the following maximum values: **U_i = 250V I_i = 1.3A**

The effective internal capacitance and inductance are negligibly small. Additionally the maximum effective capacitance and inductance of the firmly connected cable have to be considered with C_i=110pF/m und L_i=0.7µH/m.

Enclosure IP68 - 10bar (EN 60529)

Material

Housing	Stainless steel 316 /316L
Cable gland	PA6: blue, 4...8mm
Seal	Perbunan (NBR)
Cable	LiYCY/EB: blue, Ø 5.8mm
Shield	shielded, but not connected
Cable cores	2 x 0,75mm ²
Core colours	WH, BN
Type label	Polyester: silver, black printing

Operating conditions

Media temperature	Ambient temperature	Temperature class
-50°C...+150°C	-20°C...+65°C	T3 (200°C)
-50°C...+135°C	-20°C...+65°C	T4 (135°C)
-50°C...+100°C	-20°C...+65°C	T5 (100°C)
-50°C...+85°C	-20°C...+65°C	T6 (85°C)

Media temperature	Temperature of liquid within the float chamber
Ambient temperature	Temperature of air around the magnetic switch
Temperature class	Specified max. surface temperature

Grounding

A connection to protection ground is only guaranteed if both fastening clamps are used to fix the magnetic switch to the float chamber. If the float chamber does not have electrical continuity to protective ground, or if only one fastening clamp can be used for fixing the switch, the connection must be made with the foreseen screw clamp of the switch.

Fixation

When ordering level indicators with switches, hose clamps are included.

When ordering switches as spare parts, hose clamps are never included and must be ordered separately.

Only genuine parts have to be used as spare parts. In case of ordering hose clamps pipe size must be indicated:

For pipe diameter	30...40mm	Article no.	80648
For pipe diameter	40...57mm and 57...80mm	Article no.	84043

Note

EC- Type-Examination Certificate resp. IECEx CoC has additionally to be considered.


www.weka-ag.ch

The cable must be durably installed. This device is maintenance free and repair work is prohibited.

For use in areas with explosive dust consider the max. media temperature instead of max. surface temperature.


Only to use in combination with thermal non-insulated float chamber.

External electrical connections

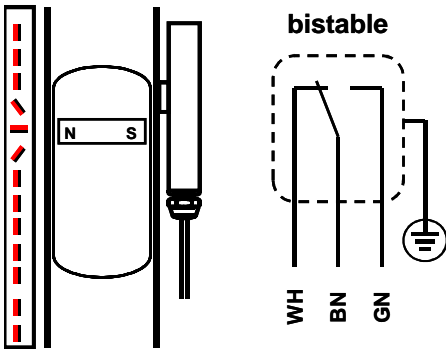

- Installed opposite to indication rail
- Cable exit downwards

Dimensions

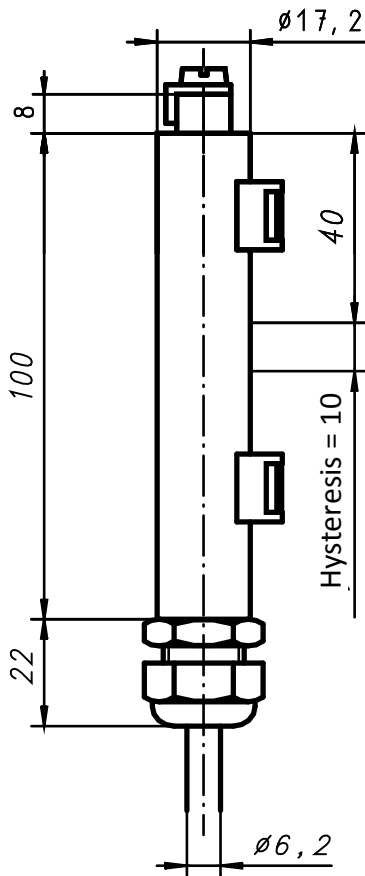

Instruction manual

Function Magnetic switch for WEKA- VLI

The magnetic switch is mounted outside of the float chamber opposite to the indication rail. The switching logic can be reversed by inverting the switch module with cable-exit upwards or by installing the switch module adjacent to the indication rail where technically authorised (see datasheet 20010501).

The magnet inside the float activates the reed switch, when the liquid in the float chamber reaches that level.

Please refer to the safety guidelines.

Product code	(standard) 31160-NI/3	with 3m cable
	31160-NI/5	with 5m cable
	31160-NI/10	with 10m cable
	31160-NI/20	with 20m cable

Switching logic

Change-over, bistable

Electrical data:

Only for connection to certified intrinsically safe circuits with the following maximum values: $U_i = 230V$ $I_i = 1.0A$

The effective internal capacitance and inductance are negligibly small. Additionally the maximum effective capacitance and inductance of the firmly connected cable have to be considered with $C_i=110pF/m$ und $L_i=0.7\mu H/m$.

Enclosure

IP68 - 10bar (EN 60529)

Material

Housing	Stainless steel 316 /316L
Cable gland	PA6: blue, 4...8mm
Seal	Perbunan (NBR)
Cable	LiYCY/EB: blue, \varnothing 6.2mm
Shield	shielded, but not connected
Cable cores	3 x 0,75mm ²
Core colours	WH, BN, GN
Type label	Polyester: silver, black printing

Operating conditions

Media temperature	Ambient temperature	Temperature class
-50°C...+150°C	-20°C...+65°C	T3 (200°C)
-50°C...+135°C	-20°C...+65°C	T4 (135°C)
-50°C...+100°C	-20°C...+65°C	T5 (100°C)
-50°C...+85°C	-20°C...+65°C	T6 (85°C)

Media temperature	Temperature of liquid within the float chamber
Ambient temperature	Temperature of air around the magnetic switch
Temperature class	Specified max. surface temperature

Grounding

A connection to protection ground is only guaranteed if both fastening clamps are used to fix the magnetic switch to the float chamber. If the float chamber does not have electrical continuity to protective ground, or if only one fastening clamp can be used for fixing the switch, the connection must be made with the foreseen screw clamp of the switch.

Fixation

When ordering level indicators with switches, hose clamps are included.

When ordering switches as spare parts, hose clamps are never included and must be ordered separately.

Only genuine parts have to be used as spare parts. In case of ordering hose clamps pipe size must be indicated:

For pipe diameter	30...40mm	Article no.	80648
For pipe diameter	40...57mm and 57...80mm	Article no.	84043

Note

EC- Type-Examination Certificate resp. IECEx CoC has additionally to be considered.

www.weka-ag.ch


The cable must be durably installed. This device is maintenance free and repair work is prohibited.

For use in areas with explosive dust consider the max. media temperature instead of max. surface temperature.

Only to use in combination with thermal non-insulated float chamber.

Classification and Marking of Flameproof enclosures Apparatus				
Inflammable Material	Incidence of inflammable material in Ex zone. Explosive media	Hazardous zones	Marking of Flameproof enclosures equipment	
			Apparatus group	Apparatus category
Gases Vapor Steam	Present continuously, frequently, or over extended periods of time	Zone 0	II	
	Present occasionally	Zone 1	II	1G
	Presence unlikely or rare and only for brief periods of time	Zone 2	II	
Inflamm-able dust cloud	Present continuously, frequently, or over extended periods of time	Zone 20	II	
	Present occasionally	Zone 21	II	1D
	Presence unlikely or rare, and only for brief periods of time	Zone 22	II	
Methane	-	Mines	I	M1
	-	Mines	I	M2



Classification of Gases, Aerosols, Vapors				
Apparatus Group	Examples of inflammable Gases			
	[Note: This is only a partial list of inflammable gases/vapors]			
IIA	IIB	IIC	Ammonia, Methane, Ethane, Propane	Ethyl alcohol, Cyclohexane, N-butane
			Town gas, Acrylonitrile	Ethylene, Ethylene oxide
			Benzene, Diesel, Furnace oil, N-hexane	Acetaldehyde
			Ethyl glycol, Hydrogen sulfide	Ethyl ether
			Hydrogen	Acetylene
				Carbon disulfide

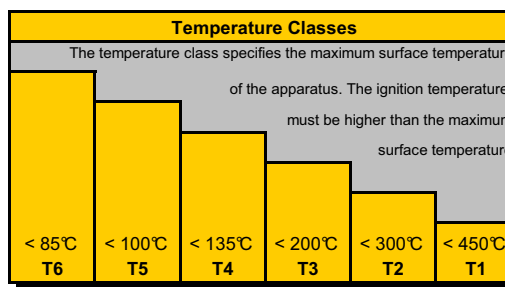

Example:


0820

II 2G Ex d IIC T6 ZELM 03 ATEX0168 -

Authority	Methods of Protection and Apparatus Marking						Certificate	Additional information	
Certificate reference number	An explosion inside the enclosure is prevented from spreading outside	Flameproof enclosures	Ex d		Zone 1 or 2	IEC EN 60079-1 (Gas) IEC EN 61241-1 (Dust)	ATEX marking and certificate number	The equipment may be used without restriction	-
	The energy in the electrical circuit in the hazardous zone is limited by design, thus preventing dangerous sparks and/or ignition temperatures	Intrinsically safe	Ex i		Zones 0, 1 and 2: Ex ia Zones 1 and 2: Ex ib	IEC EN 60079-11 (Gas) IEC EN 61241-11 (Dust)	Year of certification	The equipment may be used subject to specific conditions	X
	Principle of protection [All methods of ignition protection are not indicated here, for simplification]	Means of protection	Marking [Omitted here: Ex o, Ex p, Ex q, Ex e, Ex m, Ex n]	Symbol	Zone compatibility	Standard	Abbreviated name of certification authority (notified body)	The equipment is an "Ex" component with part-certification and therefore cannot be used as standalone.	U
							Traceability reference	Conditions	Marking

Note:

- Per ATEX guidelines, WEKA Level Indicators and accessories are **components only**, as they function only together with other equipment.
- An electrical device can be used in a temperature class lower than its certification, if operating conditions allow this.
- "Ex" components and attached metallic equipment must be connected to a common electrical ground point.



IECEX Certificate of Conformity

INTERNATIONAL ELECTROTECHNICAL COMMISSION IEC Certification Scheme for Explosive Atmospheres

for rules and details of the IECEx Scheme visit www.iecex.com

Certificate No.: IECEx ZLM 10.0003issue No.:0
Certificate history: -----

Status: **Current**

Date of Issue: **2010-12-15** Page 1 of 3

Applicant:

Weka AG
Schuerlistr.8
8344 Baeretswil
Switzerland

Electrical Apparatus: **magnetic switch type 31130-NI/* and type 31160-NI/***
Optional accessory:

Type of Protection: **Intrinsic Safety**

Marking: Ex ia IIC T6 Gb Ex iaD IIIC T85°C Db

Approved for issue on behalf of the IECEx Dipl.-Ing. Harald Zelm
Certification Body:

Position: Head of Certification Body

1. This certificate and schedule may only be reproduced in full.
2. This certificate is not transferable and remains the property of the issuing body.
3. The Status and authenticity of this certificate may be verified by visiting the [Official IECEx Website](http://www.iecex.com).

Certificate issued by:

ZELM Explosionsschutz GmbH
Siekgraben 56
D-38124 Braunschweig
Germany





IECEx Certificate of Conformity

Certificate No.: IECEx ZLM 10.0003

Date of Issue: **2010-12-15**

Issue No.: **0**

Page 2 of 3

Manufacturer:

Weka AG
Schuerlistr. 8
8344 Baeretswil
Switzerland

Manufacturing location(s):

This certificate is issued as verification that a sample(s), representative of production, was assessed and tested and found to comply with the IEC Standard list below and that the manufacturer's quality system, relating to the Ex products covered by this certificate, was assessed and found to comply with the IECEx Quality system requirements. This certificate is granted subject to the conditions as set out in IECEx Scheme Rules, IECEx 02 and Operational Documents as amended.

STANDARDS:

The electrical apparatus and any acceptable variations to it specified in the schedule of this certificate and the identified documents, was found to comply with the following standards:

- | | |
|--------------------------------------------|------------------------------------------------------------------------------------------------------------------|
| IEC 60079-0 : 2007-10
Edition: 5 | Explosive atmospheres - Part 0: Equipment - General requirements |
| IEC 60079-11 : 2006
Edition: 5 | Explosive atmospheres - Part 11: Equipment protection by intrinsic safety "i" |
| IEC 61241-11 : 2005
Edition: 1 | Electrical apparatus for use in the presence of combustible dusts - Part 11: Protection by intrinsic safety 'iD' |

*This Certificate **does not** indicate compliance with electrical safety and performance requirements other than those expressly included in the Standards listed above.*

TEST & ASSESSMENT REPORTS: A sample(s) of the equipment listed has successfully met the examination and test requirements as recorded in

Test Report:

[DE/ZLM/ExTR10.0003/00](#)

Quality Assessment Report:

[DE/ZLM/QAR09.0001/00](#)



IECEX Certificate of Conformity

Certificate No.: IECEx ZLM 10.0003

Date of Issue: **2010-12-15**

Issue No.: **0**

Page 3 of 3

Schedule

EQUIPMENT:

Equipment and systems covered by this certificate are as follows:

The magnetic switches type 31130-NI/* and type 31160-NI/* are for the generation of a signal at a level change of media.

Therefore the switch will be used together with a visual level indicator.

The type 31130-NI/* uses an on/off switch, the type 31160-NI/* uses a changeover switch.

The star (*) indicates the length in meter of the permanently connected cable.

CONDITIONS OF CERTIFICATION: NO

Annexe: IECExZLM100003-annex.pdf

ANNEX to IECEx Certificate

ZELM ex

Certificate No.: IECEx ZLM 10.0003

Issue No.: 0

Date of Issue: 2010-12-15

The permissible ambient temperature range is -20°C to $+65^{\circ}\text{C}$.

Electrical Data

Switching current circuit: type of protection Intrinsic Safety Ex ia IIC resp. Ex iaD IIIC
Only for the connection to certified intrinsically safe circuits with the following maximum values:

for type 31130-NI/*

$$\begin{aligned}U_i &= 250 \text{ V} \\I_i &= 1,3 \text{ A}\end{aligned}$$

for type 31160-NI/*

$$\begin{aligned}U_i &= 230 \text{ V} \\I_i &= 1,0 \text{ A}\end{aligned}$$

The effective internal capacitance and internal inductance of the switches are negligibly small. However the permanently connected cable has to be considered having $C = 110 \text{ pF/m}$ and $L = 0,7 \text{ }\mu\text{H/m}$.

Reference

The instruction manual has to be considered.

At media temperatures of above 85°C the temperature class has to be adapted correspondingly to the instruction manual.