


# Senlux<sup>o</sup> Besta

## Technical Information

### Option A

Typical sealing of standard level switch  
OPG 04

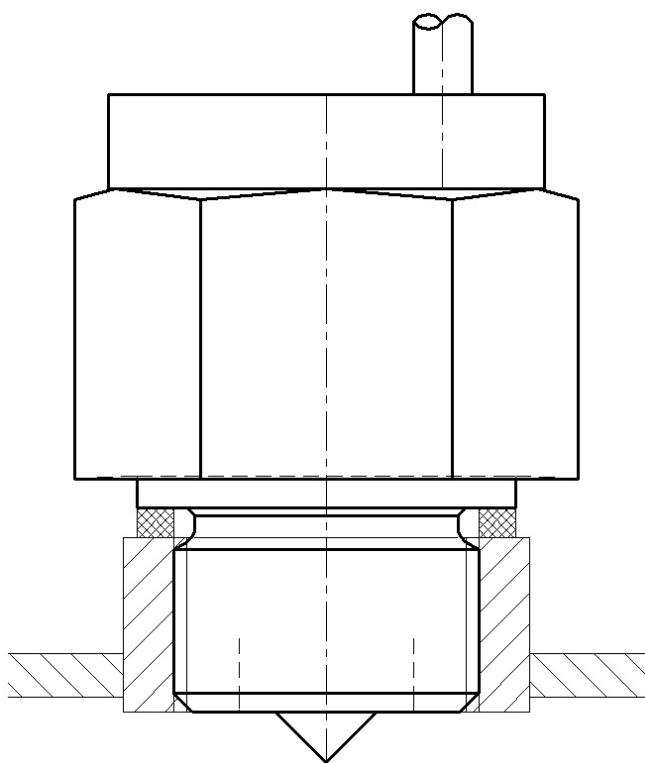

### Option B

Sealing of 3 pcs test units OPG 04

